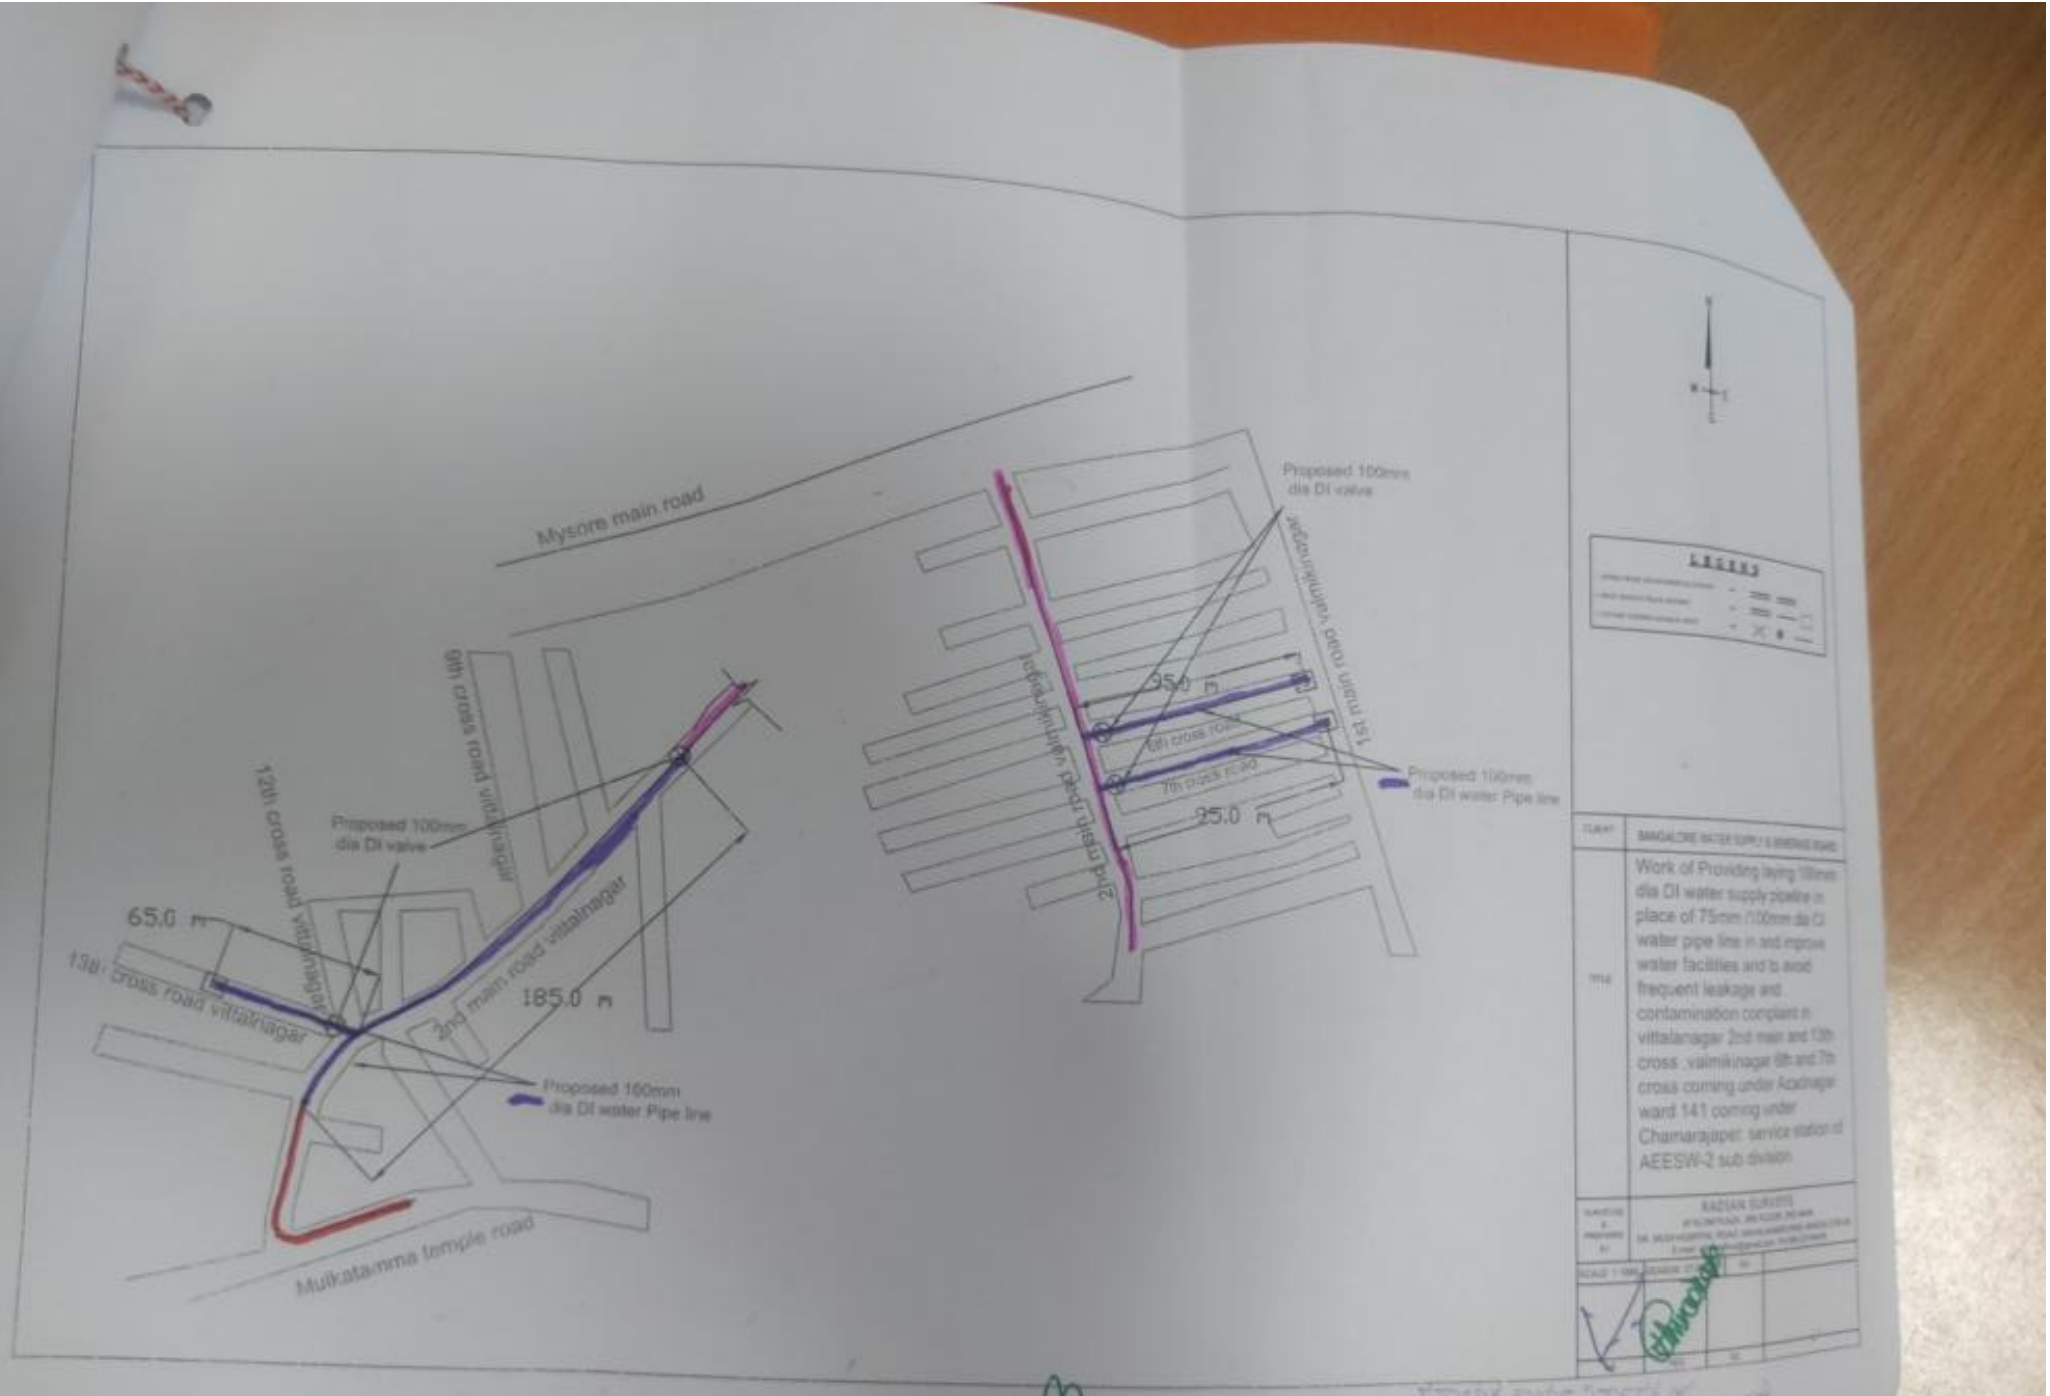
Mysore main road
9th cross road vittalnagar
12th cross road vittalnagar
Proposed 100mm dia DI valve
65.0 m
13th cross road vittalnagar
2nd main road vittalnagar
185.0 m
Proposed 100mm dia DI water Pipe line
Mulkatamma temple road
Proposed 100mm dia DI valve
1st main road valmikinagar
2nd cross road valmikinagar
25.0 m
9th cross road
7th cross road
25.0 m
Proposed 100mm dia DI water Pipe line
Work of Providing laying 100mm dia DI water supply pipeline in place of 75mm /100mm da CI water pipe line in and ingrow water facilities and to avoid frequent leakage and contamination complaint in vittalanagar 2nd main and 13th cross ,valmikinagar 9th and 7th cross coming under Azadnagar ward 141 comng under Chamarajapet service station of AEESW-2 sub division

E.E.(SW)-1

ಸಹಾಯಕ ಅಭಿಯಂತರರ ಕಛೇರಿ
ಸಂ.2 (ಪೂರ್ವ-ಪಶ್ಚಿಮ) ಉಪವಿಭಾಗ ಮಂಜುನಾಥ
ಬಿ.ಜಿ.ಪಿ.ಎಲ್, ಬೆಂಗಳೂರು-560004.

hes are to be ... water line and to impr... consumers ...

Estimate for the work of Providing and laying 100mmdia DI water pipe line in place of 100/75 mm dia CI water pipeline and improve water facilities and to avoid frequent leakage and Contamination Complaint in Vittalnagar 2nd main and 13th cross, Valmikinagar 6th and 7th cross coming Azadnagar ward 141 coming under Chamarajapet service station of AEESW-2 Sub Division

ಸಹಾಯಕ ಕಾರ್ಯ ನಿರ್ವಾಹಕ ಅಭಿಯಂತರರು
ಸಂ.2 (ದಕ್ಷಿಣ-ಪಶ್ಚಿಮ) ಉಪವಿಭಾಗ, ಬೆಂ.ಜ.ಮಂ
ವಿ.ವಿ.ಪುರಂ, ಬೆಂಗಳೂರು-560004.

E.E.(SW)-1

replaced with ... and to improve ... apply to the conc... water line ...

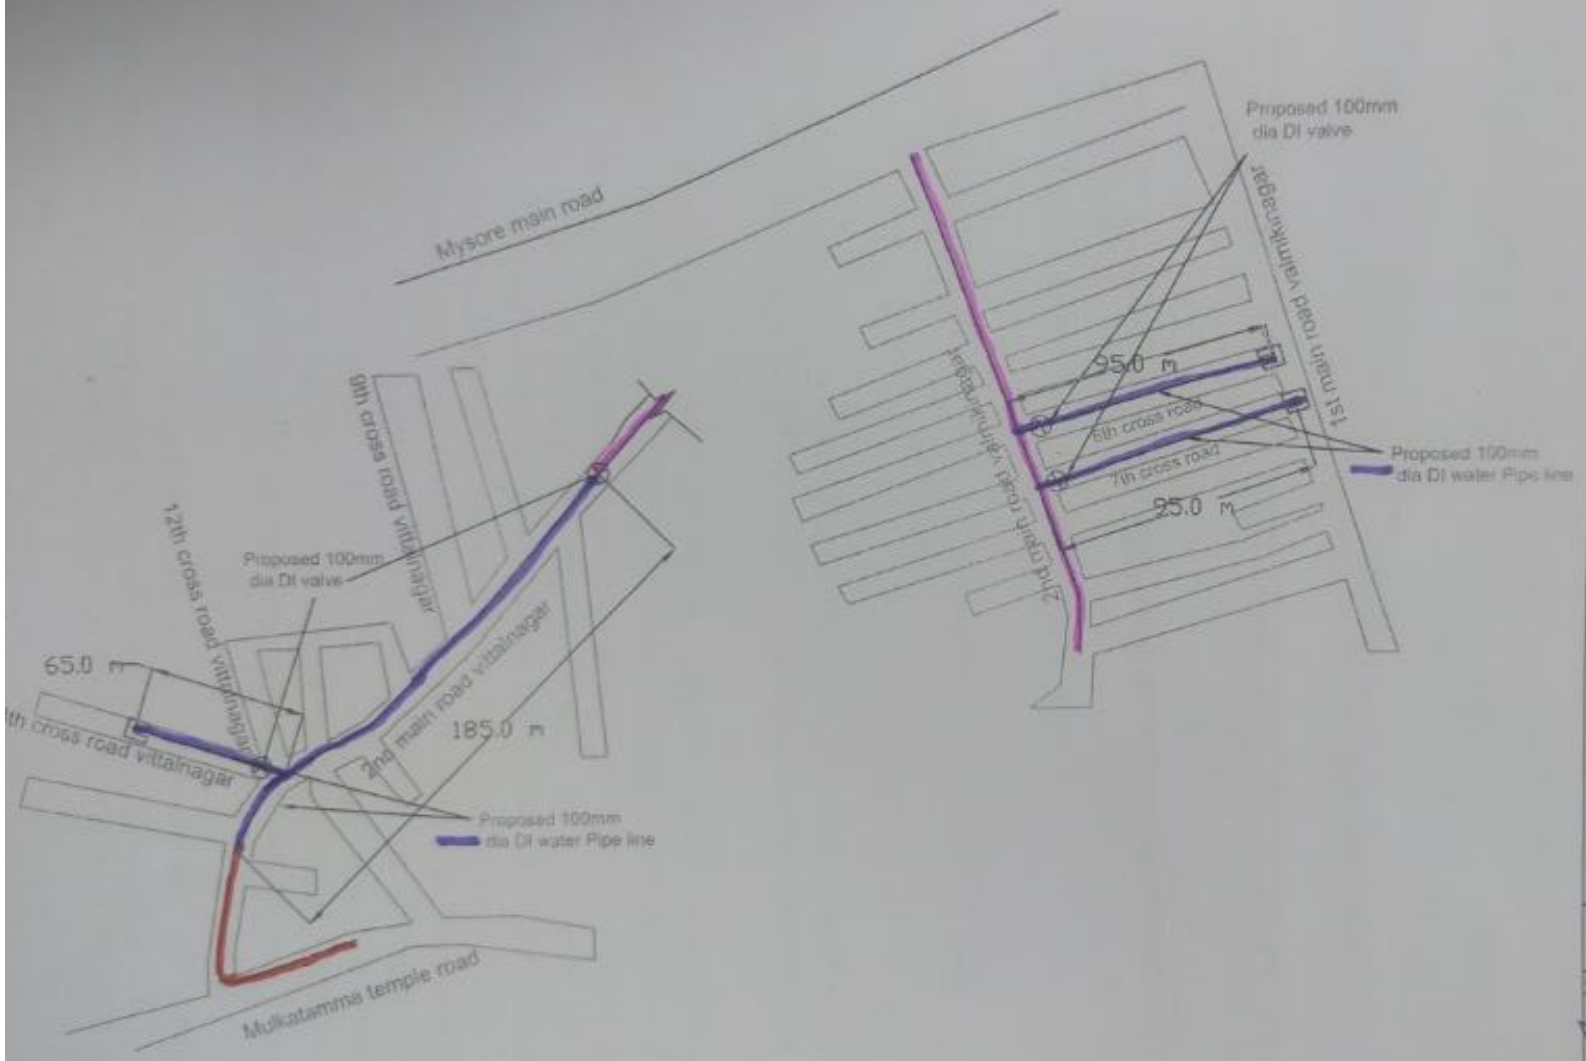

N
W E
S

LEGEND

CLIENT	BANGALORE WATER SUPPLY & SEWERAGE BOARD
TITLE	Work of Providing laying 100mm dia DI water supply pipeline in place of 75mm /100mm dia CI water pipe line in and improve water facilities and to avoid frequent leakage and contamination complaint in vittalanagar 2nd main and 13th cross ,valmikinagar 6th and 7th cross coming under Azadnagar ward 141 coming under Chamarajapet service station of AEESW-2 sub division
SURVEYED & PREPARED BY	RADIAN SURVEYS

E.E.(SW)-1